


**NOTE:**  
FOR NON-NAILABLE SUBSTRATES,  
FASTENERS MUST BE USED ONLY  
AT STUD FRAMEWORK LOCATIONS

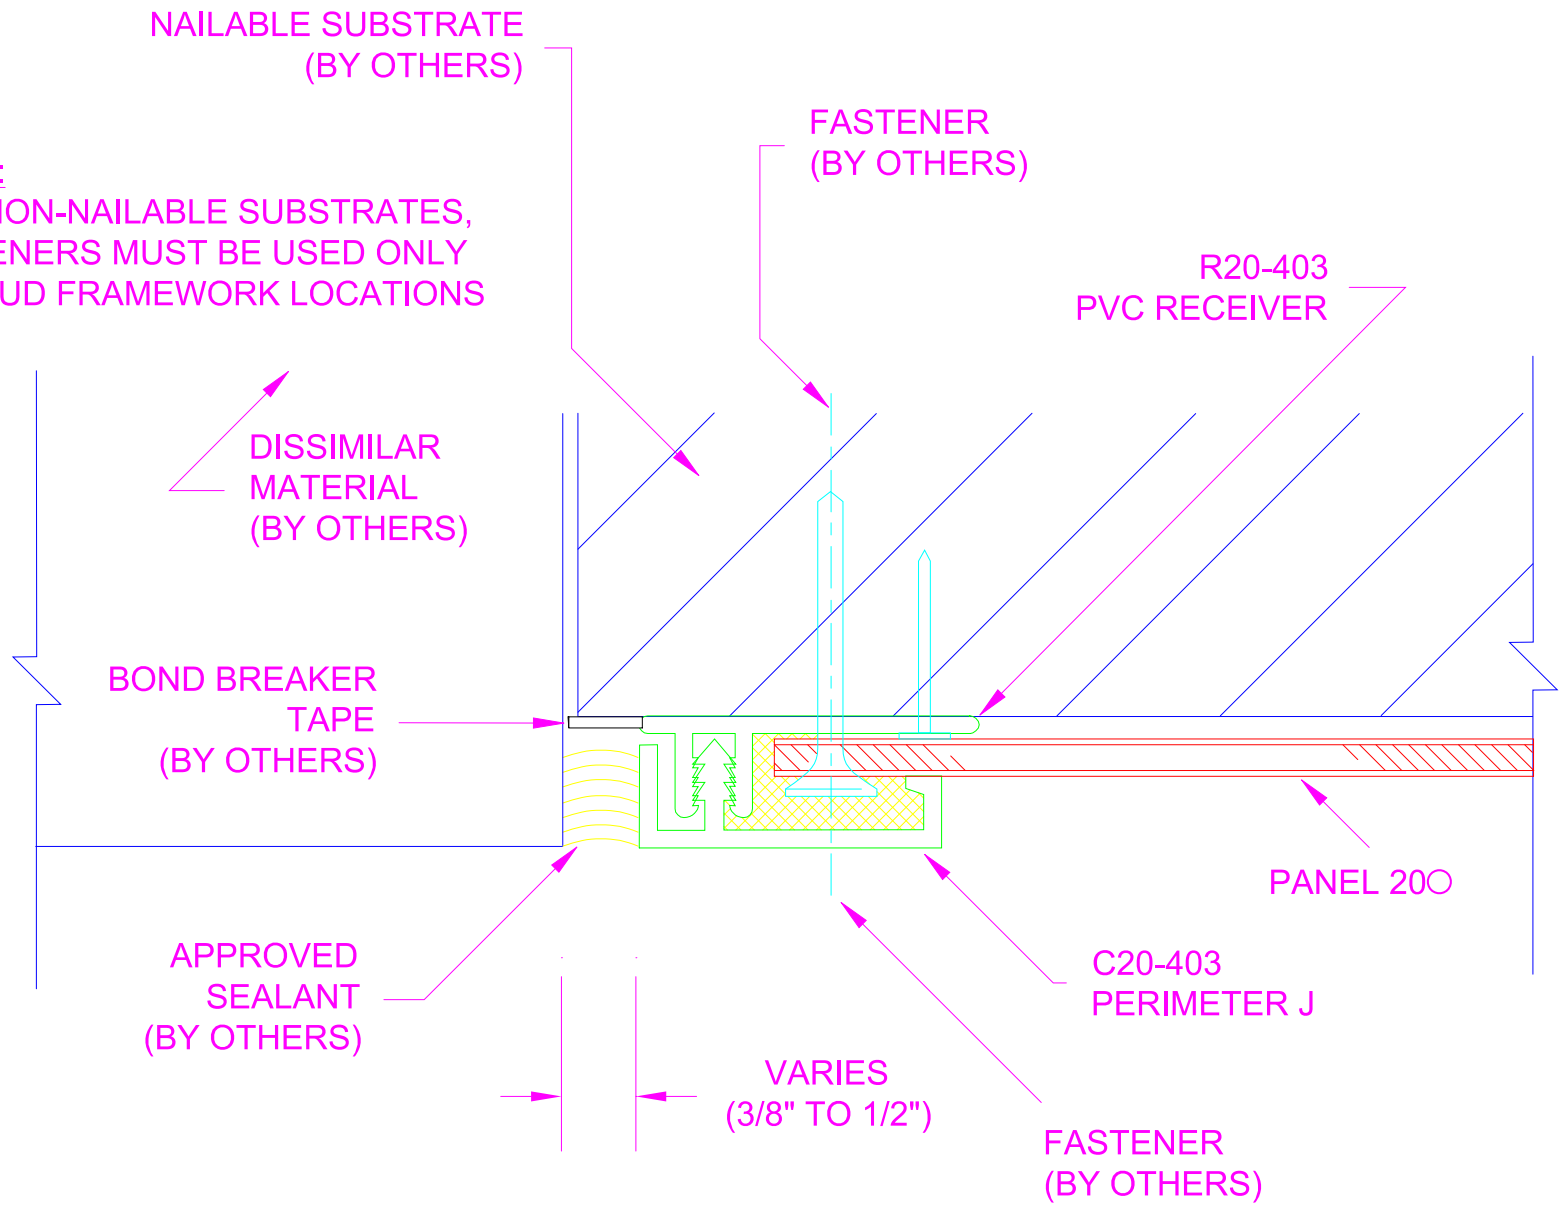

6A

DISSIMILAR MATERIAL, OPTION 1